



RELE-SC automation scheme



Alarm	
STATUS	DI
MEASUREMENT	AI
CONTROL	DO
ADJUSTMENT	AO
AUXILIARY EQUIPMENT	

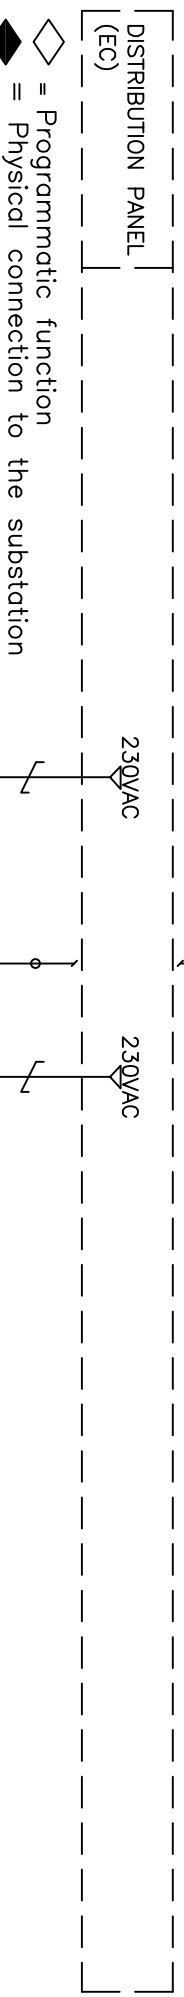

◇ = Programmatic function
 ◆ = Physical connection to the substation

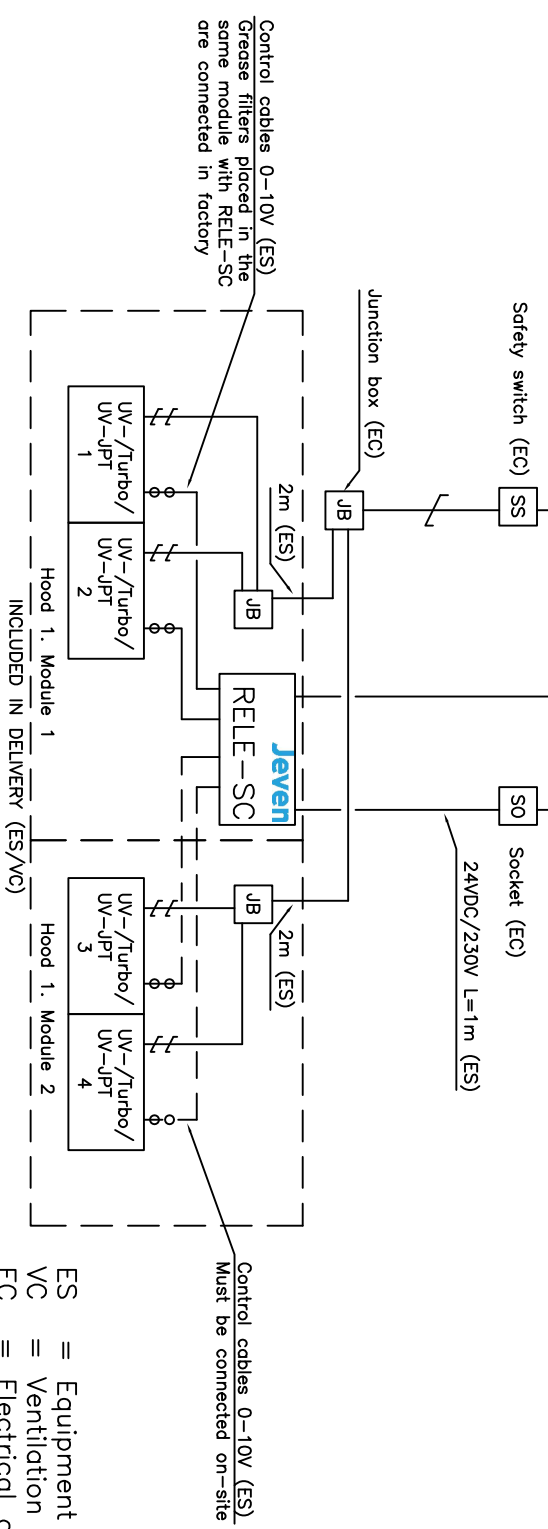

- = 230VAC, Connection Jeven (ES)
- = Control cables 0–10V, Jeven (ES), connection (EC)
- /— = 230VAC, wiring (EC), connection (EC)
- = BACnet or Modbus –interface, wiring (EC), connection (AC)

- ES = Equipment supplier (Jeven)
- VC = Ventilation contractor
- EC = Electrical contractor
- AC = Automation contractor

The operation authorization for grease filters is set by locking the power supply to the operation of the exhaust fan by relay control. Operation (on/off) is controlled with the building automation time program via the BACnet IP or Modbus TCP interface.